

# XFS SERIES EXHAUST SHUTTER FANS

For use in garages, sheds, workshops and more!



FRONT VIEW



Canarm's **XFS series** wall exhaust fans are ideal for commercial applications. They feature smooth, quiet, reliable, maintenance free operation. Available in 12" to 36" sizes - fans are single, 2 or 3 speeds with OFF and come complete with a 9' cord and grounded plug. The fans have a durable steel construction with powder coat black finish and quiet, aluminum shutters with tie bar to maximize airflow. Installation is easy - simply mount the fan with 4 screws, plug it in and turn it on!

## FEATURES


- Smooth, quiet, reliable, maintenance free operation.
- Available in 12" to 36" sizes.
- 12" and 16" models are 3 speed
- 20" to 30" models are 2 speed.
- 36" model is single speed.
- Durable steel construction with powder coat black finish.
- Swept back, high efficiency, low noise blade design.
- Shutters have a small magnet to prevent flapping and provide a superior seal.
- Quiet, aluminum shutters with tie bar to maximize airflow.
- Strong powder coated OSHA guarding inside.
- ETL certified
- Euro design outside rotor motor for higher efficiency.
  - Totally enclosed with sealed ball bearings
  - Pull chain speed control
  - 9 foot cord with 115 volt, 3-prong plug
- Fans shipped totally assembled.

## SPECIFICATIONS

MODEL	FAN SIZE	MOTOR HP	SPEED	VOLTS	NET WEIGHT	FAN RPM	CFM at 1/8" SP	HIGH SPEED SOUND LEVEL dB(A)	MAX AMPS	MAX AMBIENT TEMP
XFS12	12"	1/12	3	115	19 lbs	1600/1420/1150	1100/900/800	58	0.8 / 0.8 / 0.7	90°C/194°F
XFS16	16"	1/8	3	115	27 lbs	1630/1450/1330	2300/2000/1800	58	2.0 / 1.8 / 1.6	74°C/158°F
XFS20	20"	1/4	2	115	40 lbs	1140/1050	3300/2900	68	2.3 / 2.0	70°C/158°F
XFS24	24"	1/2	2	115	56 lbs	1140/1070	4700/3800	72	5.0 / 4.3	70°C/158°F
XFS30	30"	1/2	2	115	72 lbs	1080/980	6400/5000	71/68	4.9/4.3	70°C/158°F
XFS36	36"	1	1	115	88 lbs	943	6339	76	7.2	70°C/158°F



Tie bar aluminum shutters


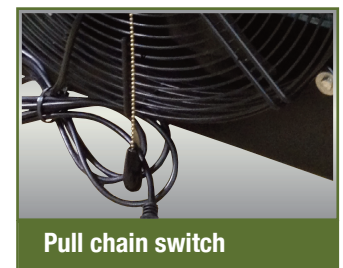


Pull chain switch

## DIMENSIONS


Note: Dimensions subject to change

MODEL	A X A SQUARE	B	C	D (c/c)	E SQR	N (# OF LOUVRES)	FRAMING	CARTON DIMENSIONS		
								Length	Height	Width
XFS12	16 7/8"	8 3/8"	5"	14 7/8"	13 1/2"	3	14" x 14"	20"	20"	12"
XFS16	20 7/8"	9 1/2"	5"	18 7/8"	17 1/2"	4	18" x 18"	25"	25"	13"
XFS20	24 7/8"	9 1/2"	5"	22 7/8"	21 1/2"	5	22" x 22"	28"	28"	13"
XFS24	28 7/8"	11 1/8"	5"	26 7/8"	25 1/2"	6	26" x 26"	32"	32"	15"
XFS30	34 7/8"	12 1/2"	5"	32 7/8"	31 1/2"	7	34" x 34"	38"	38"	15.75"
XFS36	40 7/8"	14 1/2"	5"	38 7/8"	37 1/2"	8	40" x 40"	44"	44"	17"

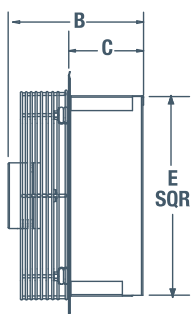

## ACCESSORIES

Optional galvanized weather hood.



### OPTIONAL WEATHER HOOD

FAN SIZES	HOOD #
12"	GH-XF12
16"	GH-XF16
20"	GH-XF20
24"	GH-XF24

# XFS SERIES EXHAUST SHUTTER FANS



To determine the proper XFS Fan for your applications, use the following formula.

**Number of cubic feet in room / Number of minutes per air change = Required CFM Capacity**

**EXAMPLE:** A general office, (see chart) which requires an air change every ten minutes, would require the following fan capacity.

**If office is 100' x 40' x 10' = 40,000 cubic ft; 40,000 cubic ft / 10 minutes per air change = 4000 Required CFM**


From the chart, you would select a fan that is rated at 4000 CFM at 1/8" S.P. (Static Pressure)

Application	Minutes per Air Change	Application	Minutes per Air Change	Application	Minutes per Air Change	Application	Minutes per Air Change
Assembly Hall	7	Church	15	Foundry	4	Pressing Room	1
Attic	2	Classroom	6	Garage	5	Projection Booth	2
Auditorium	10	Dance Hall	5	General Office	10	Summer Cooling	1
Barber Shop	6	Department Store	6	Gymnasium	8	Toilet	3
Basement	8	Dry Cleaning	5	Laundry	2	Transformer Room	1
Battery Room	4	Engine Room	6	Locker Room	3	Warehouse	12
Boiler Room	1	Factory	6	Machine Shop	8	Welding Shop	2
Bowling Alley	5	Forge Room	3	Plating Room	3		

## ATTIC VENTILATION


### CAUTION!

Attic temperatures can get very high and exceed the high temperature protection device, shutting down the fan if there is not enough air change to keep the attic at a temperature below 120 °F.

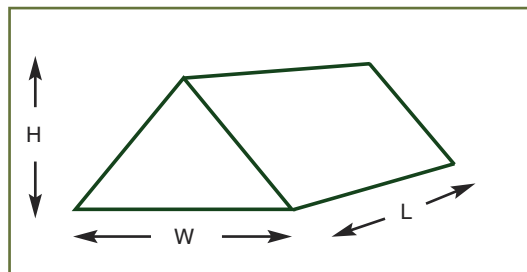

Gabled Roof

$$\text{Volume} = L \times W \times 1/2 H$$

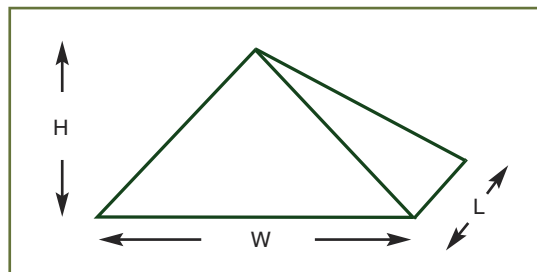

Pyramidal Roof

$$\text{Volume} = L \times W \times 1/3 H$$

Recommended air changes in an attic are about 2-3 minutes per air charge (MIN/AC) to keep the temperatures down. (2 minutes in southern climates and 3 minutes in northern climates.)

$$\text{Using 2 minutes, required exhaust CFM} = \frac{\text{Total Volume}}{2 \text{ MIN/AC}}$$

This provides your required CFM of the exhaust fan, BUT there must be enough venting to supply fresh air to the attic space. A good rule of thumb is 1.5 ft<sup>2</sup> for every 1000 CFM of airflow.

### Example:

**Southern Climate**  $\frac{6000 \text{ ft}^3}{2} = 3000 \text{ CFM}$   
Use XFS20

**Southern climate inlet opening** =  $3000 \times \frac{1.5}{1000} = 4.5 \text{ ft}^2$

**Northern Climate**  $\frac{6000 \text{ ft}^3}{3} = 2000 \text{ CFM}$   
Use XFS16

**Northern climate inlet opening** =  $2000 \times \frac{1.5}{1000} = 3 \text{ ft}^2$